


Wiring Diagram Fig. 13
For 1574

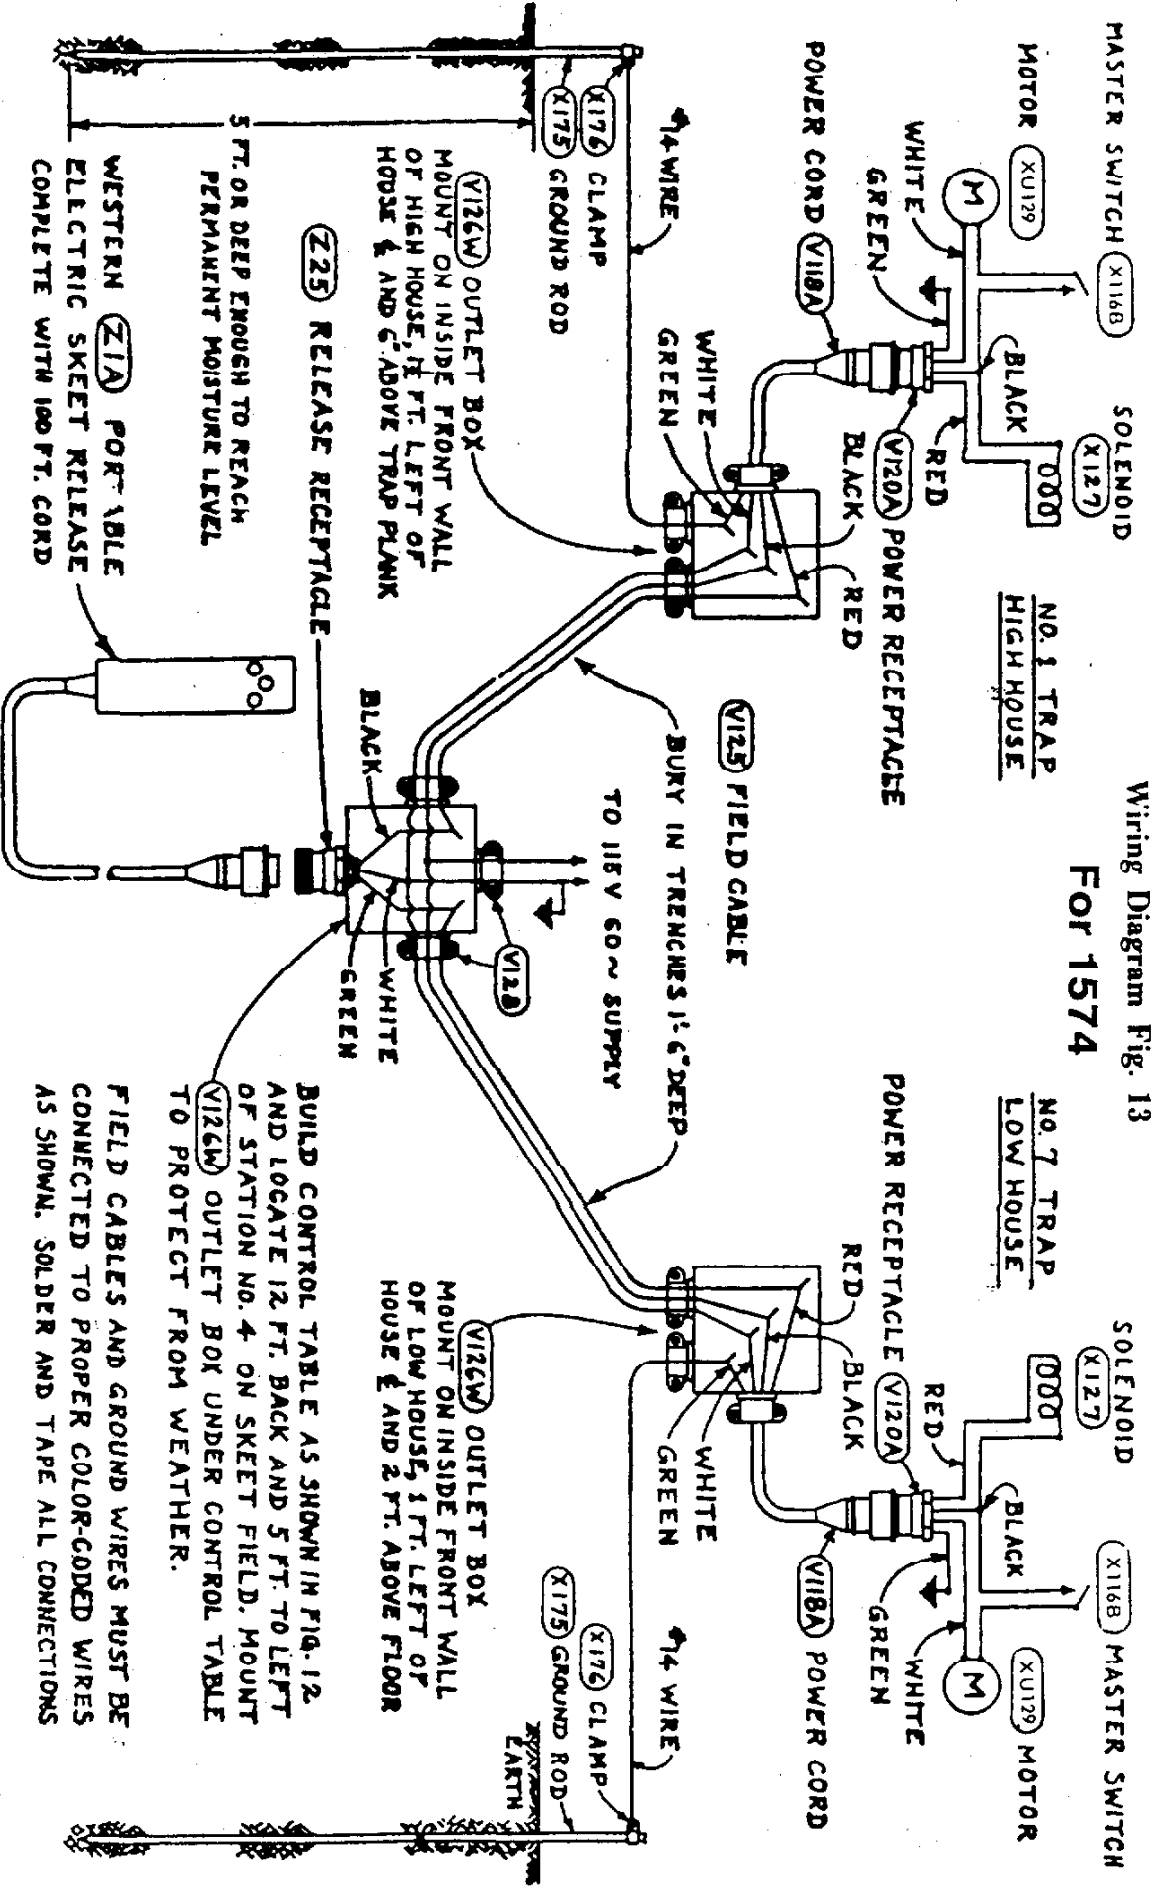

WARNING - Electrical installations must be made in accordance with National Electrical Code and applicable local codes!

BUILD CONTROL TABLE AS SHOWN IN FIG. 12 AND LOCATE 12 FT. BACK AND 5 FT. TO LEFT OF STATION NO. 4 ON SKEET FIELD. MOUNT (V126W) OUTLET BOX UNDER CONTROL TABLE TO PROTECT FROM WEATHER.

FIELD CABLES AND GROUND WIRES MUST BE CONNECTED TO PROPER COLOR-CODED WIRES AS SHOWN. SOLDER AND TAPE ALL CONNECTIONS

(V126W) OUTLET BOX
MOUNT ON INSIDE FRONT WALL OF HIGH HOUSE, 1 FT. LEFT OF HOSE & AND 6" ABOVE TRAP PLANK

(Z25) RELEASE RECEPTACLE
5 FT. OR DEEP ENOUGH TO REACH PERMANENT MOISTURE LEVEL

(Z1A) PORTABLE ELECTRIC SKEET RELEASE COMPLETE WITH 100 FT. CORD